




THRUST COLLARS ON ASBESTOS CEMENT PIPE

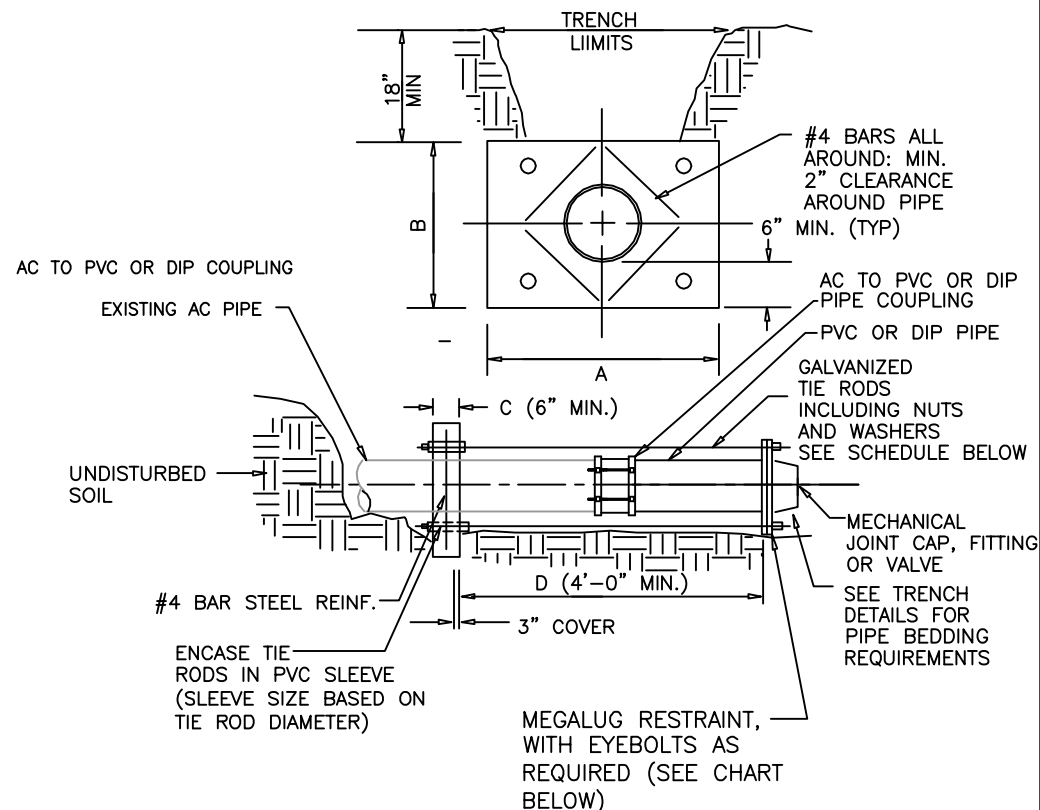

NOTES:

1. ADDITIONAL REINFORCEMENT SHALL BE AS SPECIFIED BY THE ENGINEER. AND APPROVED BY SEMINOLE COUNTY.
2. MINIMUM COMPRESSIVE STRENGTH FOR CONCRETE SHALL BE 2500 PSI.
3. BEDDING, BACKFILL, AND COMPACTION SHALL BE AS SPECIFIED ELSEWHERE IN THE STANDARD DRAWINGS AND SPECIFICATIONS.
4. ALL FORM BOARDS SHALL BE REMOVED PRIOR TO BACKFILL.
5. NO ALLOWANCE SHALL BE MADE FOR FRICTION BETWEEN THE PIPE WALL AND THE THRUST COLLAR.
6. DESIGN PRESSURE: _____ PSI. *
7. FOR RESTRAINING THE THRUST COLLAR ON PVC PIPE, USE